
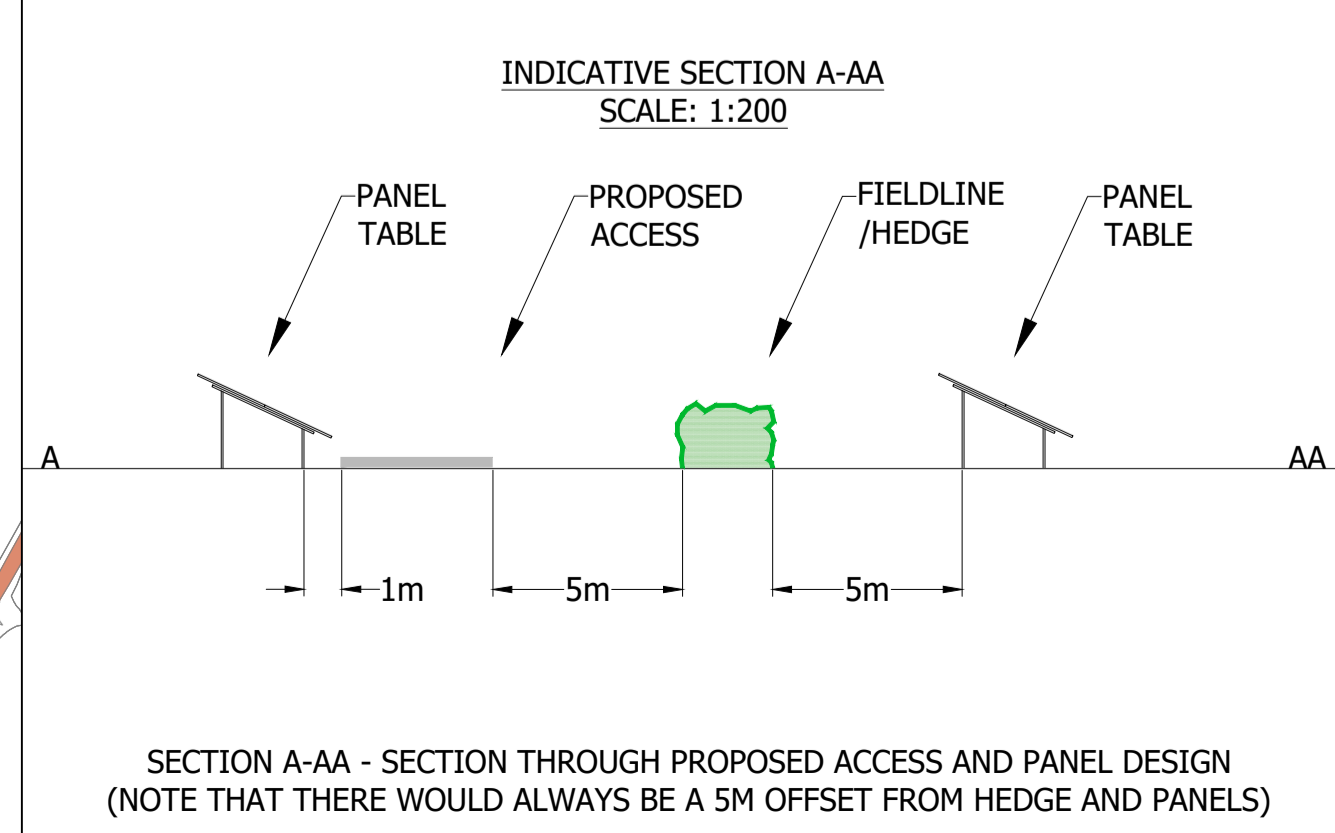
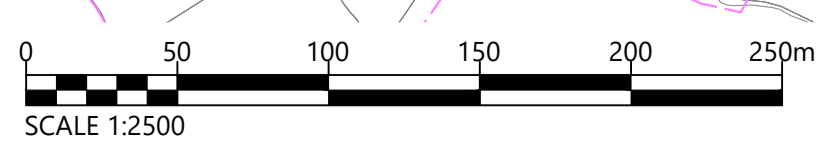


- KEY**
- Site Boundary
 - Potential Developable Area
 - 2V24 Table
 - 2V12 Table
 - Proposed Perimeter Fencing
 - Proposed Substation Compound
 - Proposed Inverters / Transformers
 - Proposed Access Tracks
 - Existing Public Roads
 - Overhead Wooden Pole Line (33kV)
 - Overhead Power Lines (400kV)
 - Public Right of Way (PRoW)
 - 5m Contours
 - 6m Buffer of Ditches
 - 6m Buffer of Overhead Wooden Pole Line
 - 10m Buffer of Onsite Woodland
 - 10m Buffer of Public Rights of Way
 - 10m Buffer of Roads
 - 14m Buffer of Overhead Power Line
 - 100m Buffer of Heritage Designations
 - 100m Buffer of Residential Dwellings

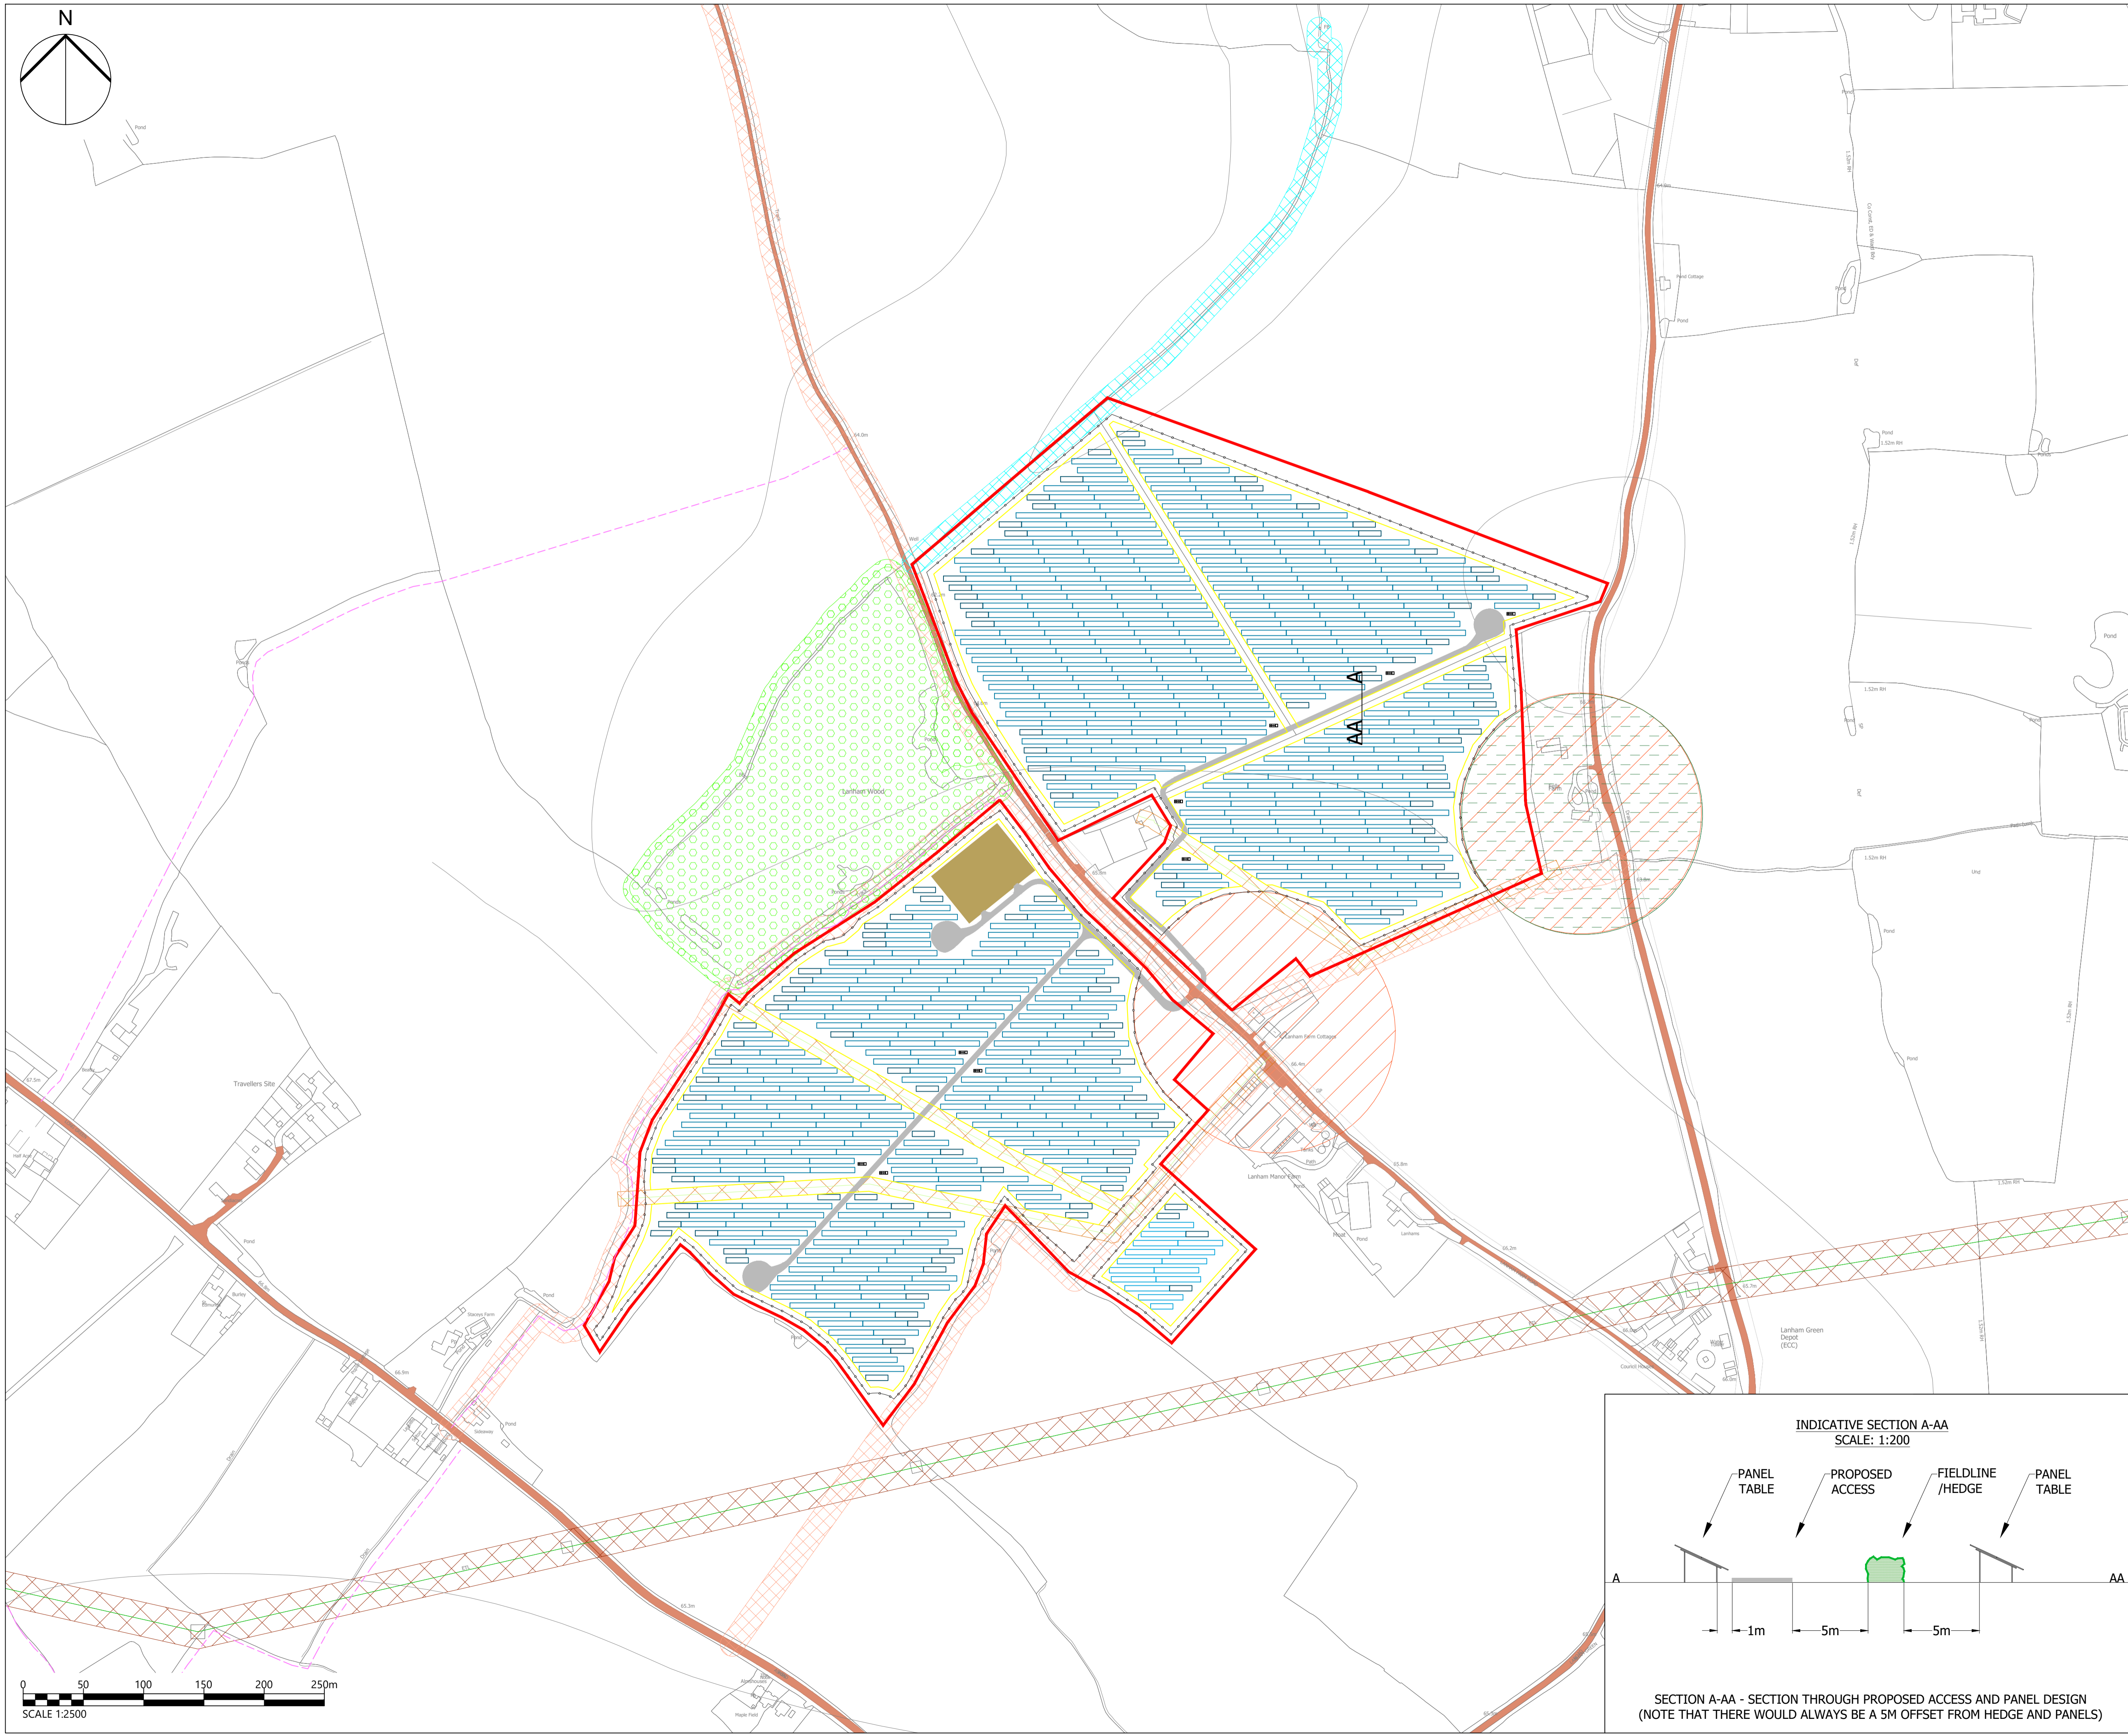

THIS DRAWING HAS BEEN PREPARED IN ACCORDANCE WITH THE SCOPE OF WORK APPOINTMENT WITH ITS CLIENT AND IS SUBJECT TO THE TERMS OF THAT APPOINTMENT. ARCUS ACCEPTS NO LIABILITY FOR ANY USE OF THIS DOCUMENT OTHER THAN BY ITS CLIENT AND ONLY FOR THE PURPOSES FOR WHICH IT WAS PREPARED AND PROVIDED.

NOTES:

1. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT DOCUMENTATION.
2. ALL DIMENSIONS, CHANGES, LEVELS AND COORDINATES ARE IN METRES UNLESS OTHERWISE STATED.
3. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH THE PROJECT HEALTH & SAFETY FILE FOR ANY IDENTIFIED POTENTIAL RISKS.
4. THE DRAWING IS THE COPYRIGHT OF ARCUS AND CANNOT BE REPRODUCED IN ANY FORM WITHOUT THE EXPRESS CONSENT OF THE COMPANY. WRITTEN AND SCALD APPROVALS TO BE CHECKED ON SITE, AND ANY DISCREPANCIES SHOULD BE REPORTED TO ARCUS PRIOR TO WORK COMMENCING ON SITE.

STATUS: **DRAFT**

BASE: Reproduced from Ordnance Survey digital map data
© Crown copyright 2022. All rights reserved.
Licence number 100048606

GRID REFERENCE: 5790060,222013

PROJECT: Braintree East Solar Farm
TITLE: Indicative Site Layout
CLIENT: EDF Renewables
DATE: 25/08/2022 SCALE: 1:2,500@A1
DRAWN: EL DRAWING NO.: 4230-BTR-DR-PRE-0002
CHECKED: HB REVISION: 1

ARCUS
Arcus Consultancy Services
1C Swinagate Court East
3 Swinagate
York, YO1 8AU
tel: +44 (0)1904 715 470
www.arcusconsulting.co.uk